


# FIRE RESISTANT TANKS

(SHALL NOT EXCEED 12,000 GALLONS)

*EXCEPT FLEET FUELING*

## Protection by Distance

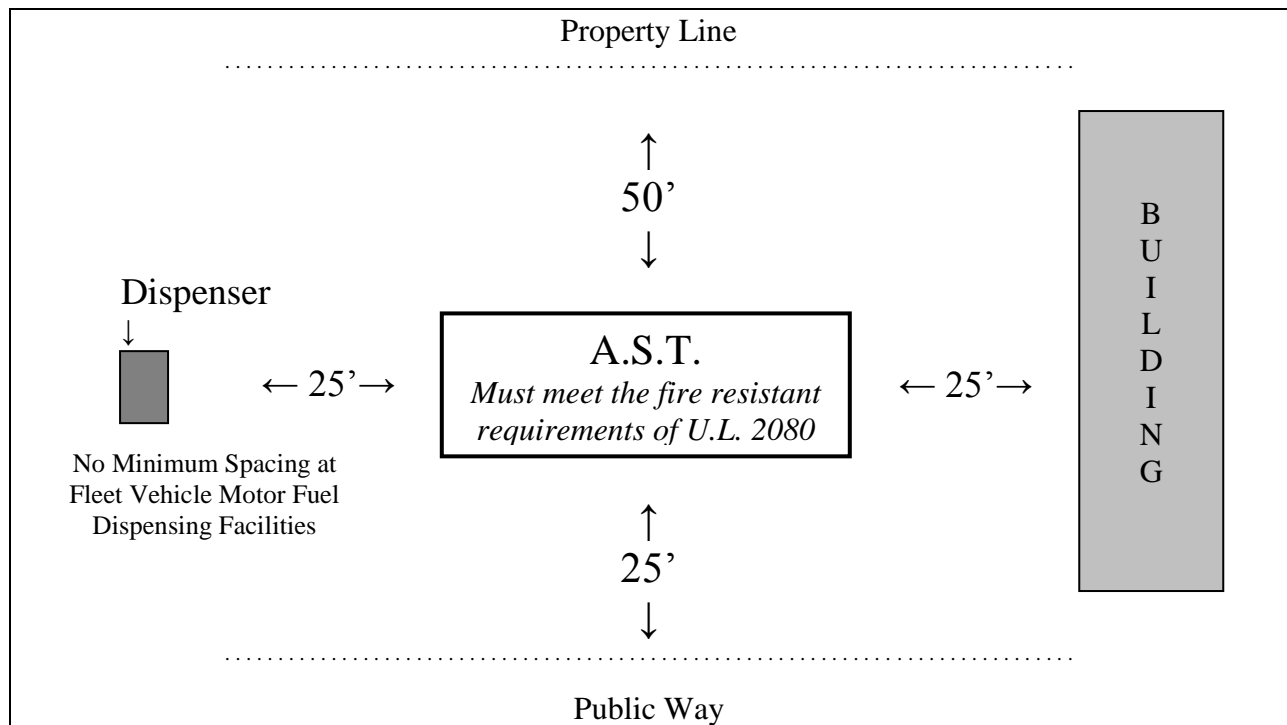

N.F.P.A. 30A 2015 ed.

Fire Resistant Tanks must ALSO meet the  
fire resistant requirements of U.L. 2080

If Vehicle Impact Protection is needed, please refer to Section 312 of 2012 International Fire Code.